


GREE DUCTFREE MINI-SPLITS OUTDOOR CONDENSING UNITS
WALL MOUNT CONFIGURATION AND ANCHOR SELECTION - WIND LOAD EXAMINATION

CODE: FMC and FBC 7th Ed. (2020) BLDG, ASCE 7-16
 MIAMI-DADE WIND SPEED = 195 MPH (Risk Cat. IV)
 For Heights <= 60 ft. (Wood stud walls only <= 20')

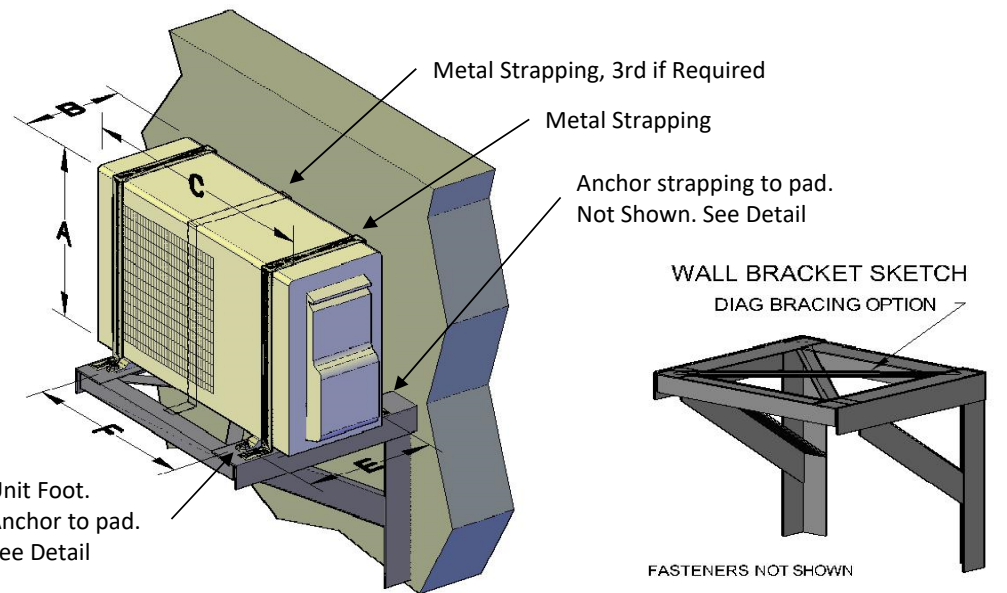

ENGINEERING CONFORMANCE ANALYSIS:
 THE TABLE SHOWS WALL MOUNT BRACKET AND ANCHOR TYPES FOR VARIOUS MODELS OF HVAC OUTDOOR EQUIPMENT UP TO 3 TONS THAT MEET THE FOLLOWING ANALYSIS: • OVERTURN • SLIDING • ANCHOR PULLOUT AND SHEAR STRENGTH • EQUIPMENT INTEGRITY.

TABLE A-2

4LIV - Series		Weight	Length C	Width B	Height	Mount	Mount
Model No.	(lbs)	(in.)	(in.)	A (in.)	E (in.)	F (in.)	
4LIV09HP115V1AO	60	26.6	11.2	21.9	12.2	17.9	
4LIV12HP115V1AO	60	26.6	11.2	21.9	12.2	17.9	
4LIV09HP230V1AO	56	26.6	11.2	21.9	12.2	17.9	
4LIV12HP230V1AO	57	26.6	11.2	21.9	12.2	17.9	
4LIV18HP230V1AO	72	29.3	11.8	21.9	13.1	20.2	
4LIV24HP230V1AO	97	35.0	13.4	26.0	14.6	22.4	
4LIV30HP230V1AO	113	36.3	14.5	29.4	15.6	24.0	
4LIV36HP230V1AO	127	36.3	14.5	29.4	15.6	24.0	

Unit Anchor	Installation Requirements						Strapping		Design Check:	
	T, in.	L, in.	U, in.	V, #	X, #	Y, #	# of Straps if Required	Gauge thickness	Nom/Reqd ≥ 1.00 = OK	Wall Anchor Check
A-4	23	22	16	2	2	2	Yes, 2	22ga	3.12	4.75
A-4	23	22	16	2	2	2	Yes, 2	22ga	3.12	4.75
A-4	23	22	16	2	2	2	Yes, 2	22ga	3.12	4.75
A-4	23	22	16	2	2	2	Yes, 2	22ga	3.12	4.75
A-4	26	23	16	2	2	2	Yes, 2	22ga	2.91	5.25
A-4	28	24	16	3	2	2	Yes, 2	22ga	2.02	4.75
A-4	30	26	16	3	3	2	Yes, 2	22ga	1.67	3.75
A-4	30	26	16	3	3	2	Yes, 2	22ga	1.68	3.75

Bri-Ko Engineering, Inc.,
 Structural Analysis
 Calc Sht: EC-1
 Description: Mechanical Equipment on Wall Mount Bracket Calc
 Spreadsheet designed by: B. Schwartz, PE
 Date data input: 2-Mar-23


Code: FBC 7th Ed. (2020) and ASCE 7-16.
Design Methodology and Load Combinations:
 Design Method: LRFD $\Phi = 0.90$
 Load Combos: FBC Eqn. 16-6 0.9 D + 1.0 W
Wind Forces: Based on ASCE 7-16, 30.3, Fig 30.3-1, C&C Walls < 60ft.
 Ultimate Design Wind Speed, Vult (3-sec gust): **195 mph** Miami Dade
 Nominal Design Wind Speed, Vasd: **151 mph**
 Risk Category: **IV** Dir., Topo., Gust Effect: **0.85** **1.00** **N/A**
 Height, h: **60 ft** Exp. Cat.: **C** Vel. Pres. Exp Coef., Kz: **1.137**
 Enclosure Cat. **N/A** $G_{cp} = 0$
Velocity Pressure $q_h = 0.00256 K_z K_{zt} K_d V^2$ (lb/ft²) $q_h = 94.0$ psf
 $p = q_h(GC_p - GC_{pi})$ (GC_p) = (1.0 ver., 1.4 lat.) F_{ver, Flat}: **94.0 psf, 131.7 psf**

Limit States: for illustration purposes only:
 Select UnitType: **4LIV** Select Model # **4LIV36HP230V1AO**
 Number of Vert Brkts is 3 Total number of anchors is 8
Loads, (lbs): P1= 976 P2= 345 P3= 390 PD= 127

Resistance to shear -unit feet:
 Reqd. Shear/leg = **263 lbs** Nominal Shear per leg: **900 lbs** CHECKS OK
Resistance to tension -unit feet:
 Reqd. Sher/anc: **518 lbs** Nom Shear per bolt: **1700 lbs** CHECKS OK


Resistance to Moment and Uplift: Use Load Combo: **0.90 D + 1.00 W**
 Overturn M at brkt bottom: **39.5 k-in** for concrete and block at max 60' ht.
 Concrete Wall: Nom Mom resist from all anchors: **82.0 k-in** CHECKS OK
 Block Wall: Nom Mom resist from all anchors: **60.0 k-in** CHECKS OK
 Overturn M at brkt bottom: **31.3 k-in** for wood at max 20' ht.
 Wood Wall: Nom Mom resist from all anchors: **55.2 k-in** CHECKS OK

Unit Integrity: If Required. Only if manufacturer does not state design wind pressure.
 Required tension on strap = **551 lbs**
 Strap width, gauge = **1.375 in.** **22ga** min gauge thickness
 Steel Strength = **45 ksi min.** Strength of strap = **817 lbs** Checks OK

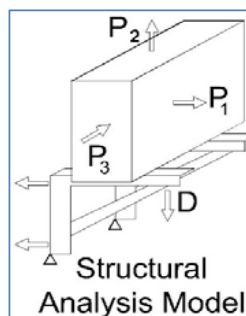

WALL BRACKET DETAIL

DIMENSION VARIABLES:
 L - Wall to outside bracket bolt
 T - Bracket width
 U - Top to bottom wall anchor distance (in.)
 V - Number of anchors in vertical bracket
 X - Number of vertical brackets
 Y - Number of anchors in top rear brkt
 MEMBER AND MATLS:
 - Steel: 3"x3"x1/8" A36
 - Aluminum: 3"x3"x1/4" 6061-T6 no welds
 - Use 3"x4" top leg when strapping

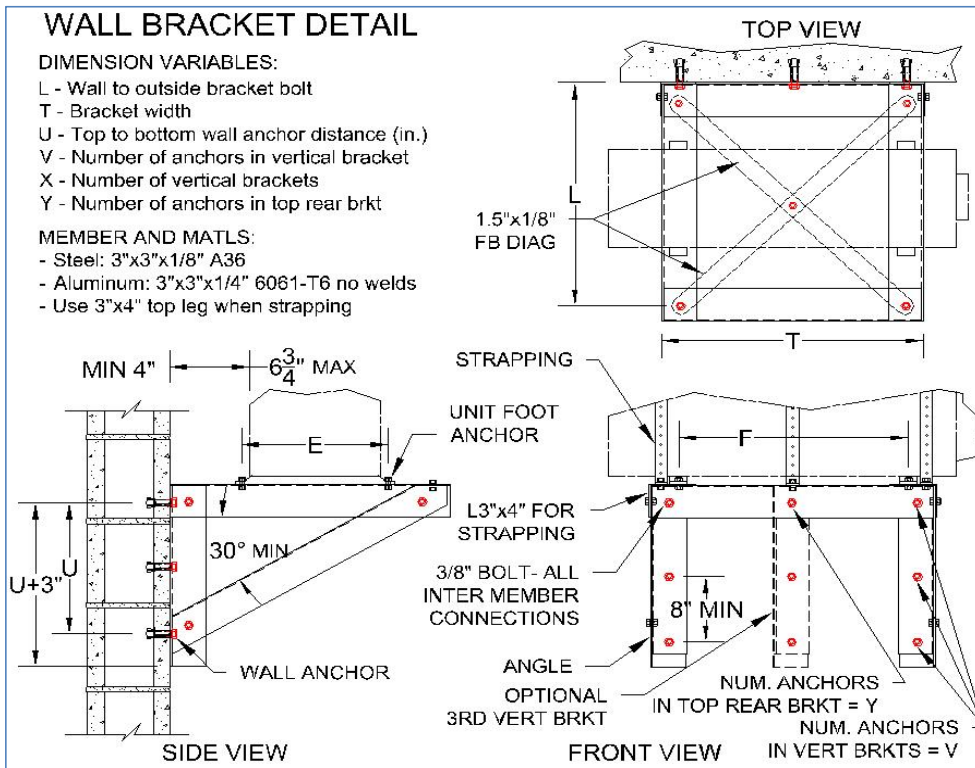

GENERAL NOTES:

1. THE ANALYSIS CONFORMS TO THE REQUIREMENTS OF THE FBC 7TH ED. (HIGH VELOCITY HURRICANE ZONE) AND ASCE 7-16 DESIGN WIND LOADS - OTHER STRUCTURES SECTION 29.4.2. NOTE: WIND FORCES ARE CONSIDERED AS MOST CLOSELY CONFORMING TO THE PRESSURES FOR SOLID ATTACHED SIGNS AND ARE DESIGNATED AS PER FIG.30.4-1 IN COMPONENTS AND CLADDING.
2. THE AC UNIT IS MOUNTED ON A BRACKET ON THE OUTSIDE OF A CONCRETE, BLOCK OR WOOD STUD WALL.
3. ANCHORS USED TO FASTEN THE UNIT TO THE WALL BRACKET ARE A307 OR HIGHER STRENGTH STEEL BOLTS. ANCHORS USED TO FASTEN THE WALL BRACKET TO WALL AS INDICATED IN THE TABLE A-2 ANCHORS DETAILS.
4. WALL BRACKET MEMBERS ARE EITHER STEEL BOLTED OR WELDED OR ALUMINUM BOLTED ONLY AS INDICATED IN THE DETAIL.
5. CLEARANCES: FASTENERS IN BRACKET METAL MUST HAVE EDGE CLEARANCES OF 1-1/2 DIAMETERS. ANCHORS IN CONC BLOCK MUST BE AT LEAST 12" FROM THE EDGE OF THE WALL.
6. UNIT INTEGRITY, IF NOT DESIGNATED BY THE MANUFACTURER FOR THE STATED WIND PRESSURES, IS ADDRESSED BY STRAPPING ATTACHED TO THE UNIT AND ANCHORED TO THE SUPPORT ANGLES. THIS RESISTS SHELL AND FRAME SEPARATION.

Bracket design parameters:
 Distance from wall to unit: -----> **6 in.**
 Distance from bottom anchor to bottom of vertical bracket: -----> **3 in.**
 Distance from foot anchor to outside of bracket width: -----> **2.5 in.**
 Outside bracket angle width: --> **3 in.**

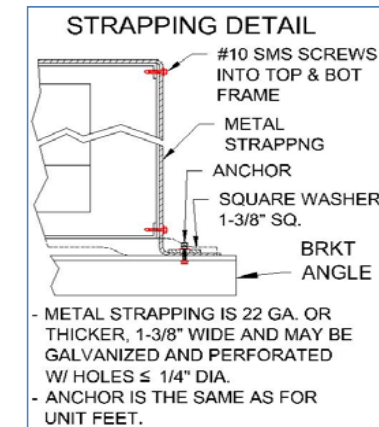


TABLE A-1 ANCHOR TYPE AND ALLOWABLE STRENGTHS (LRFD)

SYM	ANCHOR DESCRIPTION & MANUFACTURER	EMBED	STRENGTH AT MIN SPACING	
			PULL OUT (LBS)	SHEAR (LBS)
C-1	3/8" WEDGE BOLT (Powers)	2-1/2"	1025	1370
BG-1	3/8" WEDGE BOLT	3-1/2"	750	755
W-1	3/8" LAG SCREW	2-1/2"	690	320
A-4	1/4" A307 Bolt	N/A	1700	900
A-5	5/16" A307 Bolt	N/A	2500	1500

Anchor Notes: 1. Strengths for lag screws in wood are from NDS for wood construction 2005 for Southern Pine, Cd= 1.6, Cm= 1.0, Ceg= 1.0, Ct= 1.0, main member tm= 3.5", side member ts= 14 ga mtl. Strengths for other anchors are from manufacturer's specs with min. safety factor of 4. 2. Poured concrete wall with minimum f'c= 3000 psi. 3. BG-1 -Blocks (CMU) are medium weight and grout filled. One anchor per cell maximum. 4. Wood stud is minimum nominal 2"x4" with anchor centered in stud. 5. IMPORTANT: For Structure Type of Wood, Roof heights are limited to 20 ft maximum for all models.

Sheet: **ENG-1** BRI-KO ENGINEERING INC Cert. Of Auth.:#27622 tel: 954.648.6218
 Doc: **Page 1 of 1**
 Gree -4LIV Wall Mount
 Issue Date: **2-Mar-23**
 Dwn By: **B.S.**
 Dwg Size: **11x 17**
 This item has been digitally signed and sealed by Brian I Schwartz on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.